

**GLY70AA**

**COMPRESSOR**

**TECHNICAL SPECIFICATION**

**(220--240V~50Hz)**

CHANGHONG HUA-YI COMPRESSOR CO., LTD.

## INDEX

	Page
1、 Compressor Type.....	2
2、 Performance Data.....	2
3、 Running Condition.....	2
4、 Compressor Mechanical Information.....	3
5、 Compressor Shape.....	3
6、 Wiring Diagram.....	4
7、 Fixing of mounting bracket and cabinet base.....	4
8、 Assembly of starter and protector.....	5
9、 Delivery State.....	6
10、 Package、 Storage and Transportation.....	6
11、 Technical Items.....	7

## 1. Compressor Type

Compressor model	GLY70AA
Rated voltage/frequency	220--240V~50Hz
Refrigerant	R134a
Application	Low back pressure (LBP)
Cooling method	Static Cooling
Control device	Capillary tube
Motor type	RSIR
Capacitor	Without

## 2. Performance Data

Displ.(cm <sup>3</sup> )	Capacity(W) ≥95%	Inp.Pow.(W) ≤115%	Rated Current(A) ≤110%	COP (W/W) ≥95%
6.9	195	144	1.1	1.35

Testing condition:

Test conditions	LBP
	ASHRAE
Evaporating Temp.	-23.3℃
Ambient Temp.	32.2℃
Condensing Temp.	54.4℃
Suction Temp.	32.2℃
Subcooling Temp.	32.2℃


## 3. Running Condition

Ambient temp.	10~43℃
Evaporating temp.	-35~-15℃
Voltage range	187~254V
Max. condensing temp.	65℃
Max. winding temp.	130℃
Max. shell temp.	95℃
Max. discharge temp.	125℃

### 4. Compressor Mechanical Information



Oil type	POE
Oil charged	140±10ml
Weight	6.8±0.4kg
Diameter of suction tube (I.D.)	Φ6.1 <sup>+0.1</sup> <sub>0</sub> mm
Diameter of discharge tube(I.D.)	Φ4.9 <sup>+0.1</sup> <sub>0</sub> mm
Diameter of process tube (I.D.)	Φ6.1 <sup>+0.1</sup> <sub>0</sub> mm
Material of suction tube, process tube and discharge tube	copper tube
Compressor noise	≤42dB(A)
Vibration	≤0.8m/s <sup>2</sup>

### 5. Compressor Shape (connections on suction and process can not be inverted)

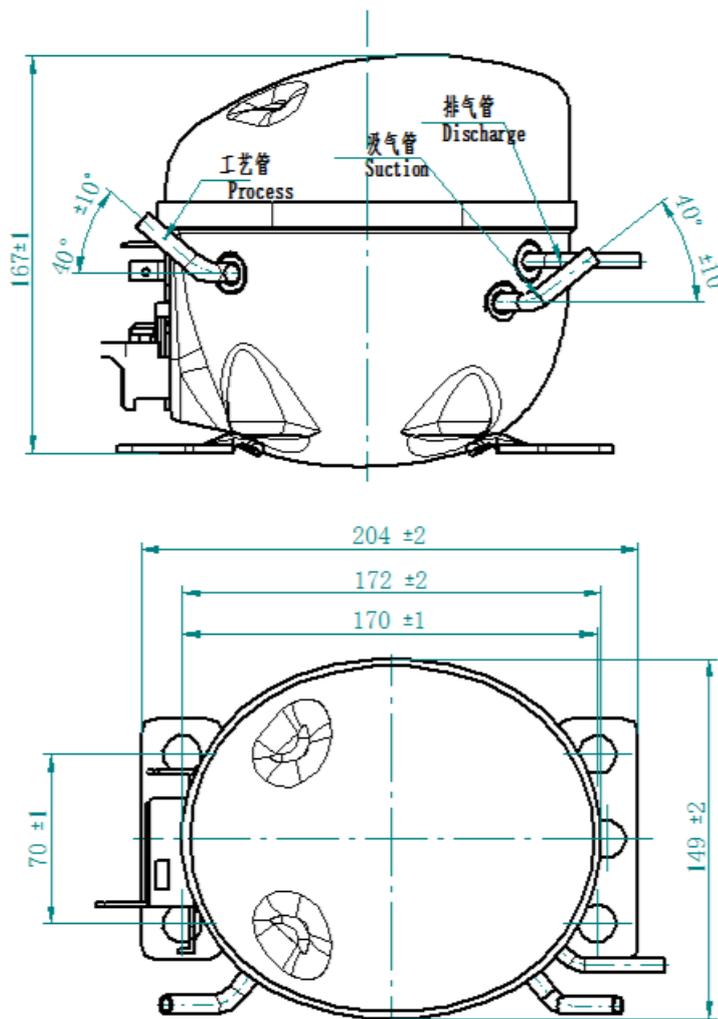


## 6. Wiring Diagram

### RSIR:

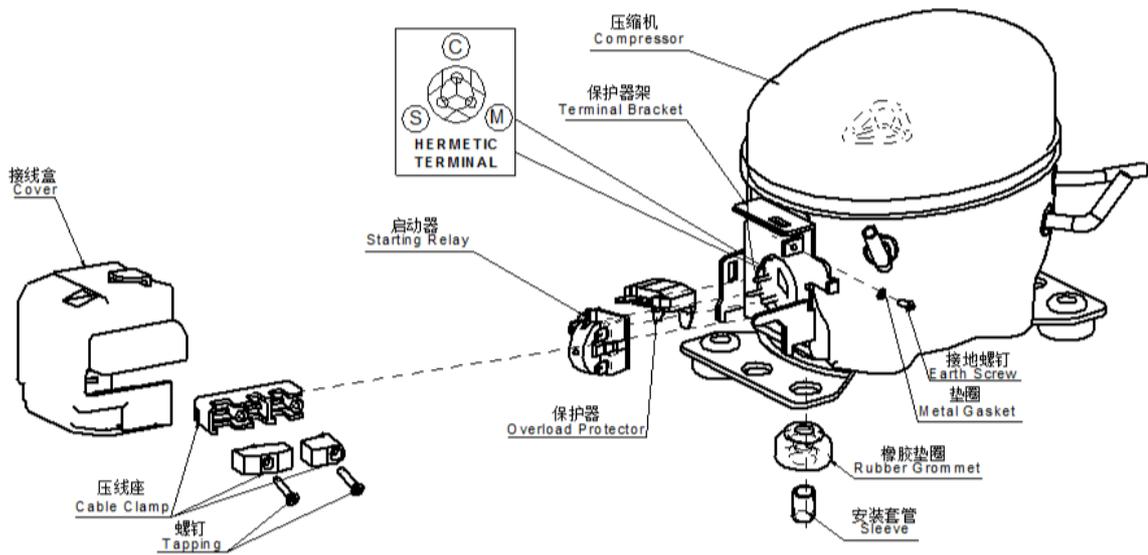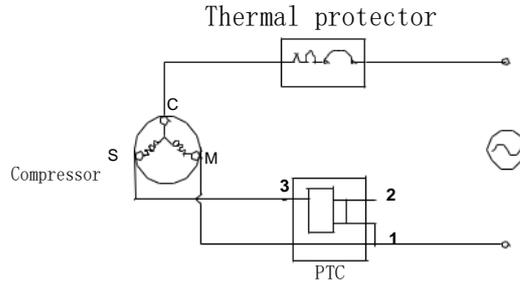

Note: Each of the starting relay, the thermal protector, the terminal cover and the screw assembly is separately provided by our company.

## 7. Rubber gasket

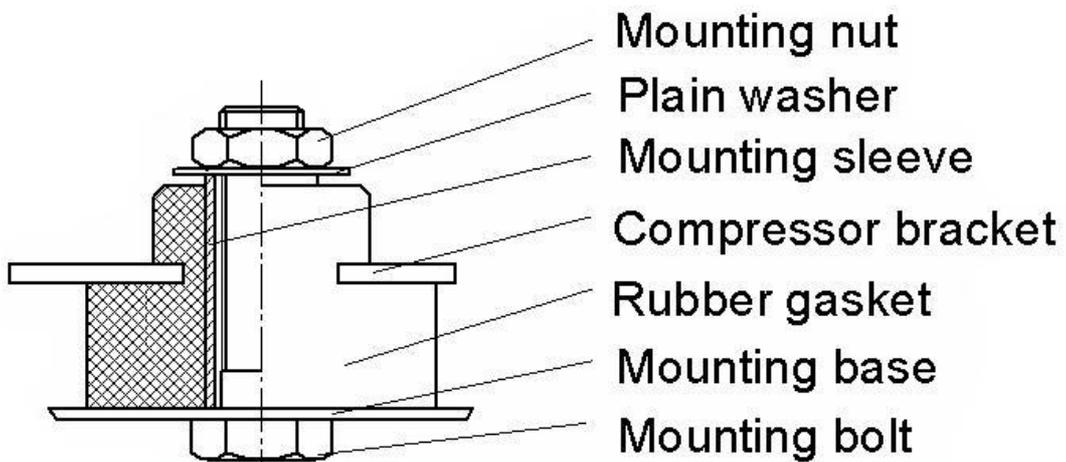


## 8.Assembly of starter and protector

### 8.1、 Starting relay

**Model:**QP2-15L/QPS2-A15MD3

**Type:** PTC

Compressor type		GLY70AA	
Starting relay	Type	QP2-15L	QPS2-A15MD3
	Trip Time	S	0.15~1.5
	Reset time	S	<80
	Max. working voltage	V	350
	Max current	A	8

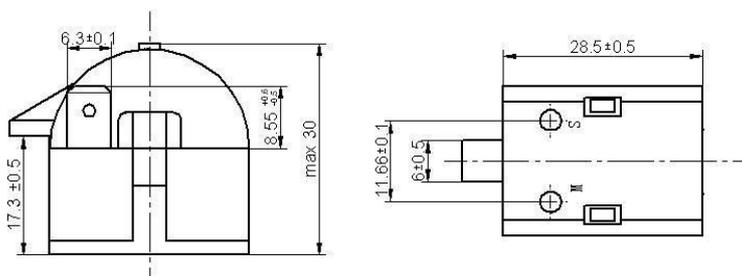

Installation force: 98N

Unload force: 25N


Flame retardant grade:UL94-V0

### 8.2 Overload protector

**Model:** BT48-135/DRB19S61A2

Compressor model		GLY70AA		
		BT48-135	DRB19S61A2	
Overload Protector	Max.T.C Amp.(25℃)	A	4.8	
	Trip time	S	7 ~ 16	
	Reset time	S	20 ~ 150	
	Open temp.	±5℃	135	
	Close temp.	±9℃	61	61
	Min. T.C. Amp.(70℃)	A	1.5 ~ 2.0	

Flammability: Anti-flammability

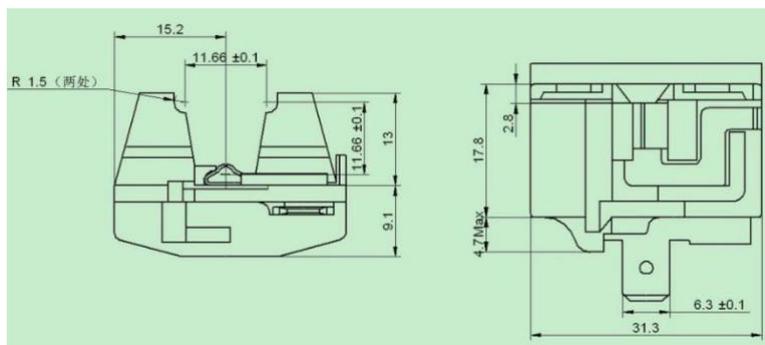

Installation force: 88N

Unload force: 12.5N

Flame retardant grade: UL94-V0

### 9. Delivery State

No.	Name	Model	Quantity	CODE
1.	<b>Compressor</b>	<b>GLY70AA</b>	<b>1pcs</b>	
2.	<i>MOUNTING ACCESSORIES</i>			
2.1.	Rubber Gasket		4 pcs	E.24.12.201S
2.2.	Plain Washer		4 pcs	CTE983-2
2.3.	Mounting Sleeve		4 pcs	CTE943-2
2.4.	Mounting Bolt	M6×30	4 pcs	GB5781-86
2.5.	Mounting Nut	M6	4 pcs	GB6170-86
3.	<i>ELECTRICAL ACCESSORIES</i>			
3.1.	Assembly of starter and protector		1 pcs	
3.2.	Cable clamp	With 2 clamps and screw	1 pcs	E.14.24.201
3.3.	Capacitor (with nut and washer)	/	/	Without
3.4.	Plastic cover		1 pcs	E.24.01.59

Notes: 1.All electrical parts and equipment assembly are supplied separately, not installed on the compressor.

2. All electrical parts and equipment assembly according to Delivery states are all provided by our company.

## 10. Package、 Storage and Transportation

Package type	unreusable
Quantity	72pcs/box
Transportation	By truck or train
Storage	Max. 2 layers
Gross Weight            Kg	525
Net Weight                Kg	495
Volume                    m <sup>3</sup>	0.84
Dimension: length×width×height (mm)	1120×820×910
Main components	Wooden supporter、 foam divider、 plastic sheet、 cardboard cover、 wrapping
Movement	Keep the compressor in normal or vertical position (a short time before compressor installed in the refrigerator).
Trans. test requirement	No allowable compressor's damage and performance loss.

## 11. Technical Items

1. After pulling off rubber plugs from the compressor tubes, please connect the compressor to the refrigeration system within 5 minutes. It is advisable to take off the first plug from process tube. No dust or humidity in the air is permitted to enter the compressor.
2. Earth connection should be fixed permanently and reliably.
3. The compressor must be mounted horizontally without tilting an angle more than 5° .
4. Maximum operating ambient temperature is at 43℃.
5. When the compressor starts, balance pressure inside refrigeration system must be less than 0.5Mpa (Absolute).
6. The compressor must not be restarted unless at an interval of more than 5 minutes.
7. Please keep the compressor always vertically and never upset it during transportation while avoiding any vibration and shock.
8. Please store the compressor in a dry and ventilated place and keep it away from any humidity.
9. Please follow the transportation warning marks on the package for layer limitation. Do not roll the whole packages when loading or unloading.
10. Storage expiry is 6 months from the date of production. If it expired, please check the nitrogen pressure inside compressor and recharge it when it is necessary.